Meewasin Valley Authority
402 Third Avenue South
Saskatoon, Saskatchewan S7K3G5
Phone (306) 665-6887 Fax (306) 665-6117

NOTICE OF HEARING
24th Street Stormwater Outfall

TAKE NOTICE that the Meewasin Valley Authority is holding a public hearing to consider **an application for development.** This public hearing is being held under Sections 11 and 20 of the *Meewasin Valley Authority Act*, SS 1979, c. M-11.1. This notice is to provide information about the matters being considered and provide notice of the Public Hearing.

Public Hearing Details

The proposed application for development will be considered by the Meewasin Valley Authority at a Public Hearing on:

December 4, 2026 at 12:00 p.m. noon

Prairie Winds Board Room, Meewasin Valley Centre
402 3rd Avenue South, Saskatoon, Saskatchewan

Any person or group may submit written comments and may make a presentation.

To attend the meeting, submit written comments, or make a presentation, please email planning@meewasin.com or phone 306-665-6887 by **10 a.m.** on the day of the hearing.

If you experience any barriers to participating in a public hearing, please make a request to Meewasin staff for accommodations.

Application Details

Applicant: Keri Kearns, City of Saskatoon
Address of Subject Lands: 501 Spadina Crescent East
File No.: 50.14.700
A site plan and selected drawings are attached to this notice. More information is available to the public at the Meewasin Valley Centre and by request.

Purpose & Effect

The applicant is requesting permission from the Authority to construct a new stormwater outfall along the riverbank to discharge stormwater into the river. Construction is scheduled for 2027.

Notice dated **November 24, 2026.**

DEVELOPMENT REVIEW APPLICATION FORM

1. **Applicant** (attach proof of estate or legal interest)

Name Keri Kearns Address 222 3rd Ave N

Postal Code S7K 0J5 Phone [redacted] Email [redacted]

2. **Representative (if any) to whom correspondence should be sent**

Name _____ Address _____

Postal Code _____ Phone _____ Email _____

3. **Legal land description**

Kiwanis Memorial, 501 Spadina Crescent E

4. **Civic Address (if applicable)**

5. **Description of the proposed Improvement or Concept Plan**

A new stormwater outfall will be constructed along the riverbank to discharge stormwater into the river. Outfall construction is scheduled for 2027.

6. **Anticipated Start Date (Month and Year)** April 2027

7. **Anticipated Completion Date (Month and Year)** October 2027

(The date range above will constitute the approval period)

8. **Construction Value** $ 601,206.25

Kearns, Keri Digitally signed by Kearns, Keri Date: 2026.09.11 15:39:39 -06'00' — 9/11/2926

Signature of Applicant — Date (YYYY-MM-DD)

_____ — _____


Signature of Representative — Date (YYYY-MM-DD)


NOTES:

- The Meewasin Valley Authority approval process is separate and apart from approvals which may be required by other agencies and jurisdictions.
- No on-site work shall commence until the Authority has approved the application.

For office use only

Received by	Date of initial submission	Date of completed submission
Carmen Ens Funk	September 11, 2026	October 16, 2026

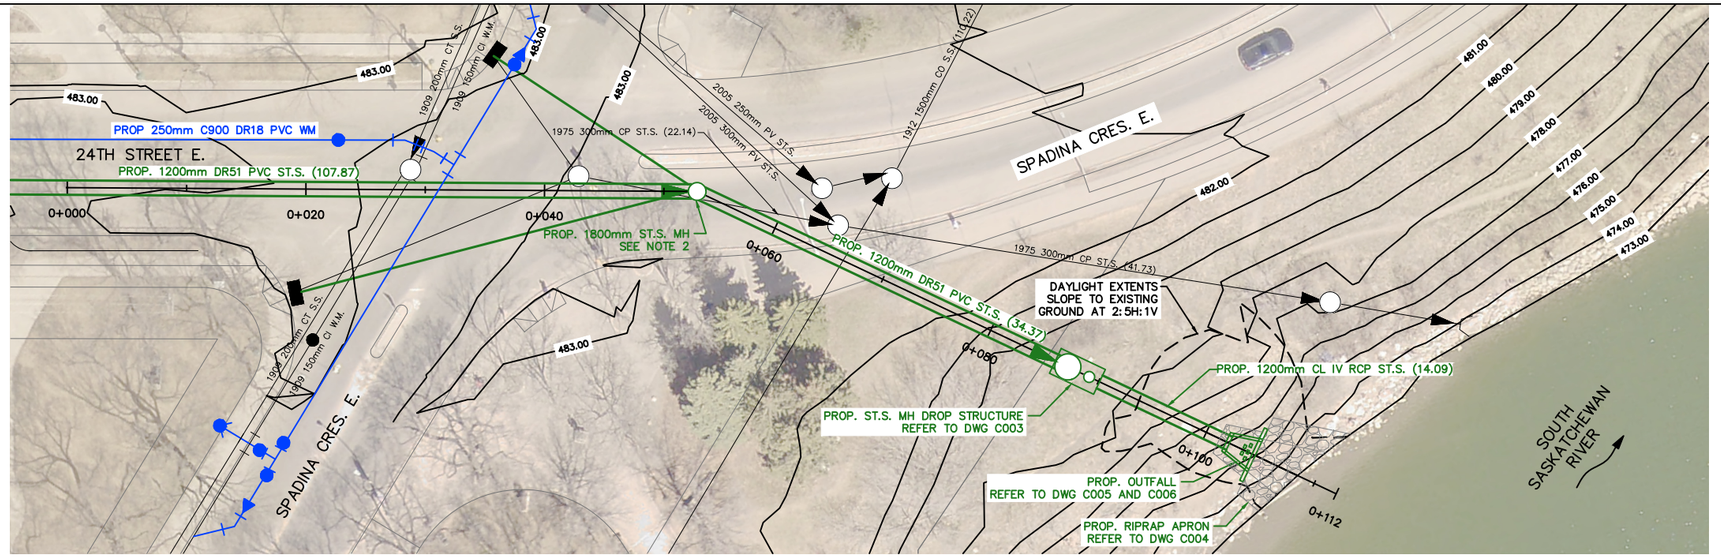

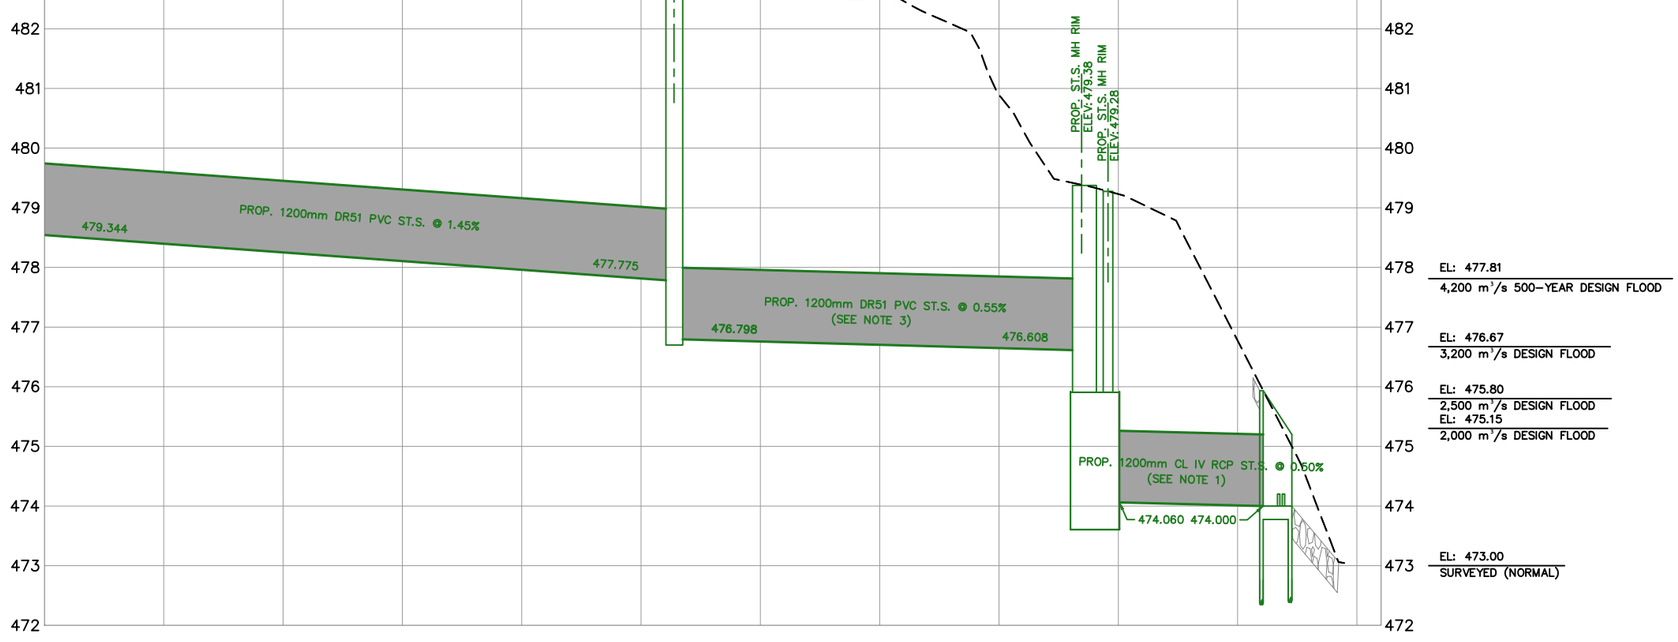

NOTES

1. RCP PIPE EMBEDMENT SHALL BE CLASS A IN ACCORDANCE WITH COS STD. DWG 102-0011-0011R001.
2. 1800mm PRECAST MH TO CONSIST OF 1800mm MONO-BASE, 1800mm RISER BARRELS (MIN. HEIGHT 2400mm), 1200mm TRANSITION SLAB, AND COS STD. 1200mm RISER BARRELS, ECCENTRIC CONE, GRADE RINGS, RUBBER ADJUSTMENT RINGS AND FRAME AND COVER.
3. ON PIPE SEGMENTS REFERENCING THIS NOTE, PIPE BEDDING AGGREGATE TO EXTEND VERTICALLY TO 300mm ABOVE PIPE CROWN.

THE CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE LOCATION AND ELEVATION OF ALL UNDERGROUND UTILITIES.

WATER MAIN PRIOR TO 1976
ASSUMED 2.75m COVER

WATER MAIN SINCE 1976
ASSUMED 2.90m COVER

3	ISSUED FOR 100%	2026-MAR-09	RFC
2	ISSUED FOR 95%	2026-FEB-13	RFC
1	ISSUED FOR 60%	2026-JAN-15	RFC
	PLAN DESCRIPTION/REVISION	DATE	BY

SEAL

Association of Professional Engineers & Geoscientists of Saskatchewan
CERTIFICATE OF AUTHORIZATION
CIMA CANADA
Number C1396
Permission to Consult held by:
Discipline: CIVIL | Sk. Reg. No.: 12178 | Signature

City of Saskatoon
Transportation and Construction Division

24th STREET FLOOD CONTROL STRATEGY

24th STREET
6th AVENUE TO RIVER
1200 DIA OUTFALL PLAN/PROFILE


ENGINEERING MANAGER

SCALES:
HOR. 1:500
VERT. 1:100

DATE


SHEET NO.

PLAN NO.
C001

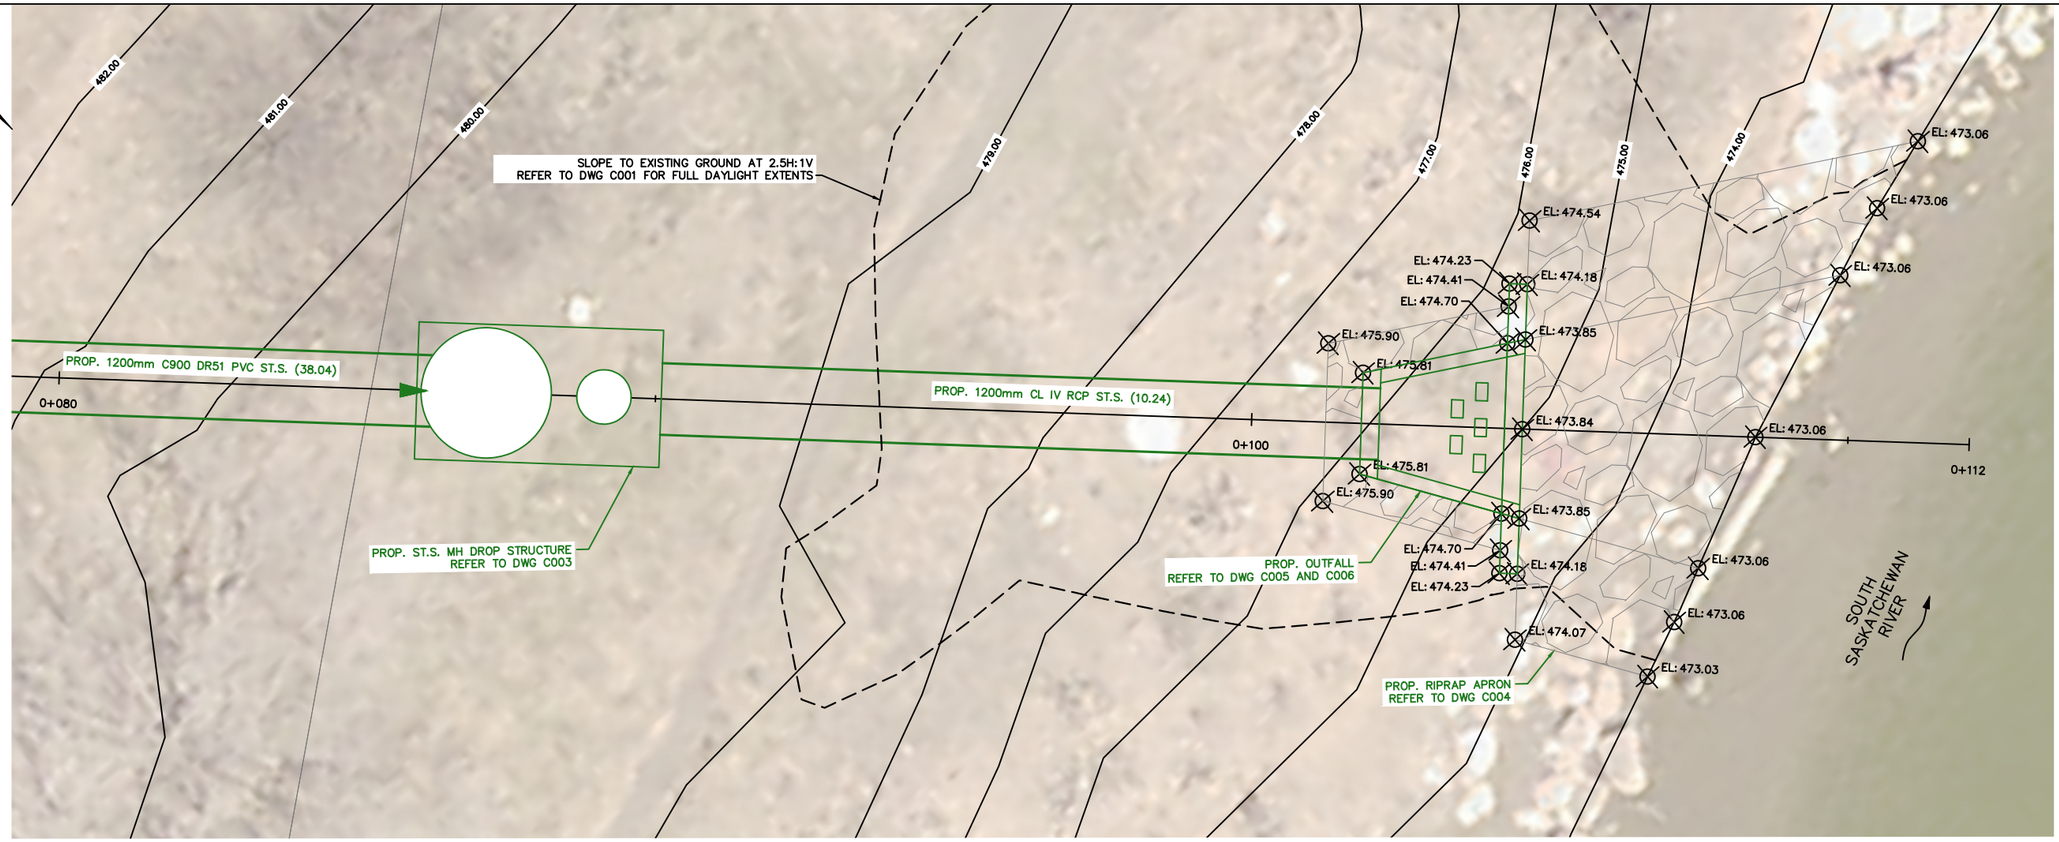

THE CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE LOCATION AND ELEVATION OF ALL UNDERGROUND UTILITIES.

WATER MAIN PRIOR TO 1976
ASSUMED 2.75m COVER
WATER MAIN SINCE 1976
ASSUMED 2.90m COVER

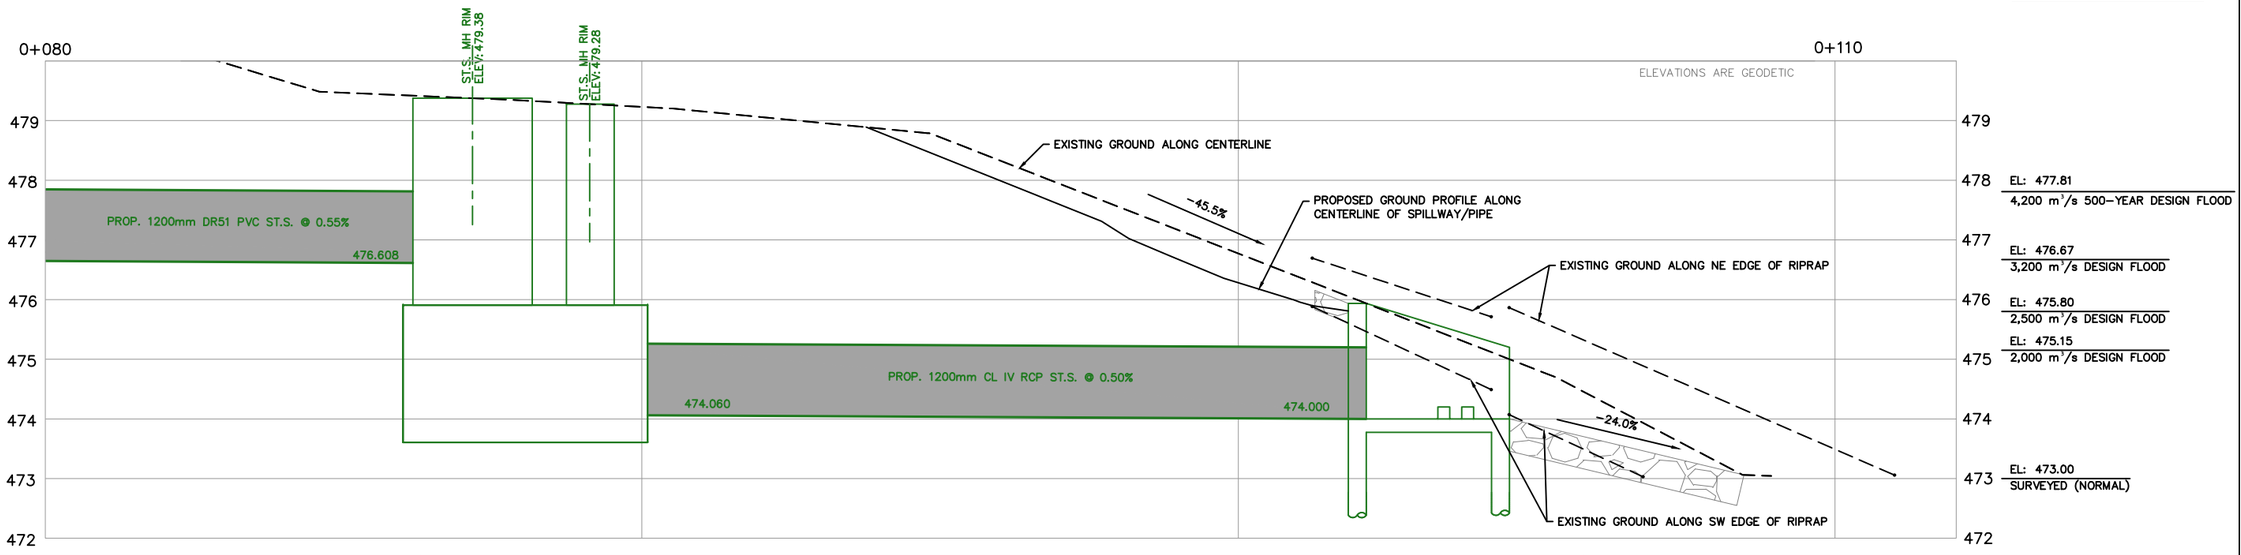

	PLAN DESCRIPTION/REVISION	DATE	BY
3	ISSUED FOR 100%	2026-MAR-09	RFC
2	ISSUED FOR 95%	2026-FEB-13	RFC
1	ISSUED FOR 60%	2026-JAN-15	RFC

SEAL

PROFESSIONAL ENGINEER
J.J. GUILLOU
MEMBER 48265
2026-08-19
YR. MN. DAY
SASKATCHEWAN

Association of Professional Engineers & Geoscientists of Saskatchewan
CERTIFICATE OF AUTHORIZATION
CIMA CANADA
Number C1396
Permission to Consult held by:

Discipline	Sk. Reg. No.	Signature
CIVIL	12178	

City of Saskatoon
Transportation and Construction Division

24th STREET FLOOD CONTROL STRATEGY

24th STREET

6th AVENUE TO RIVER

1200 DIA OUTFALL PLAN/PROFILE – DETAIL


ENGINEERING MANAGER

SCALES:
HOR. 1:100
VERT. 1:100


DATE

SHEET NO.

PLAN NO.
C002

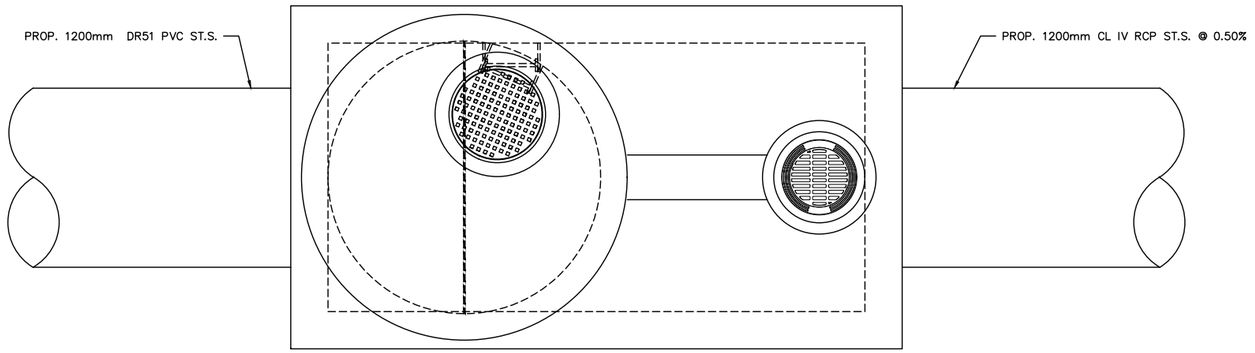


DROP STRUCTURE MANHOLE – PLAN
1:40

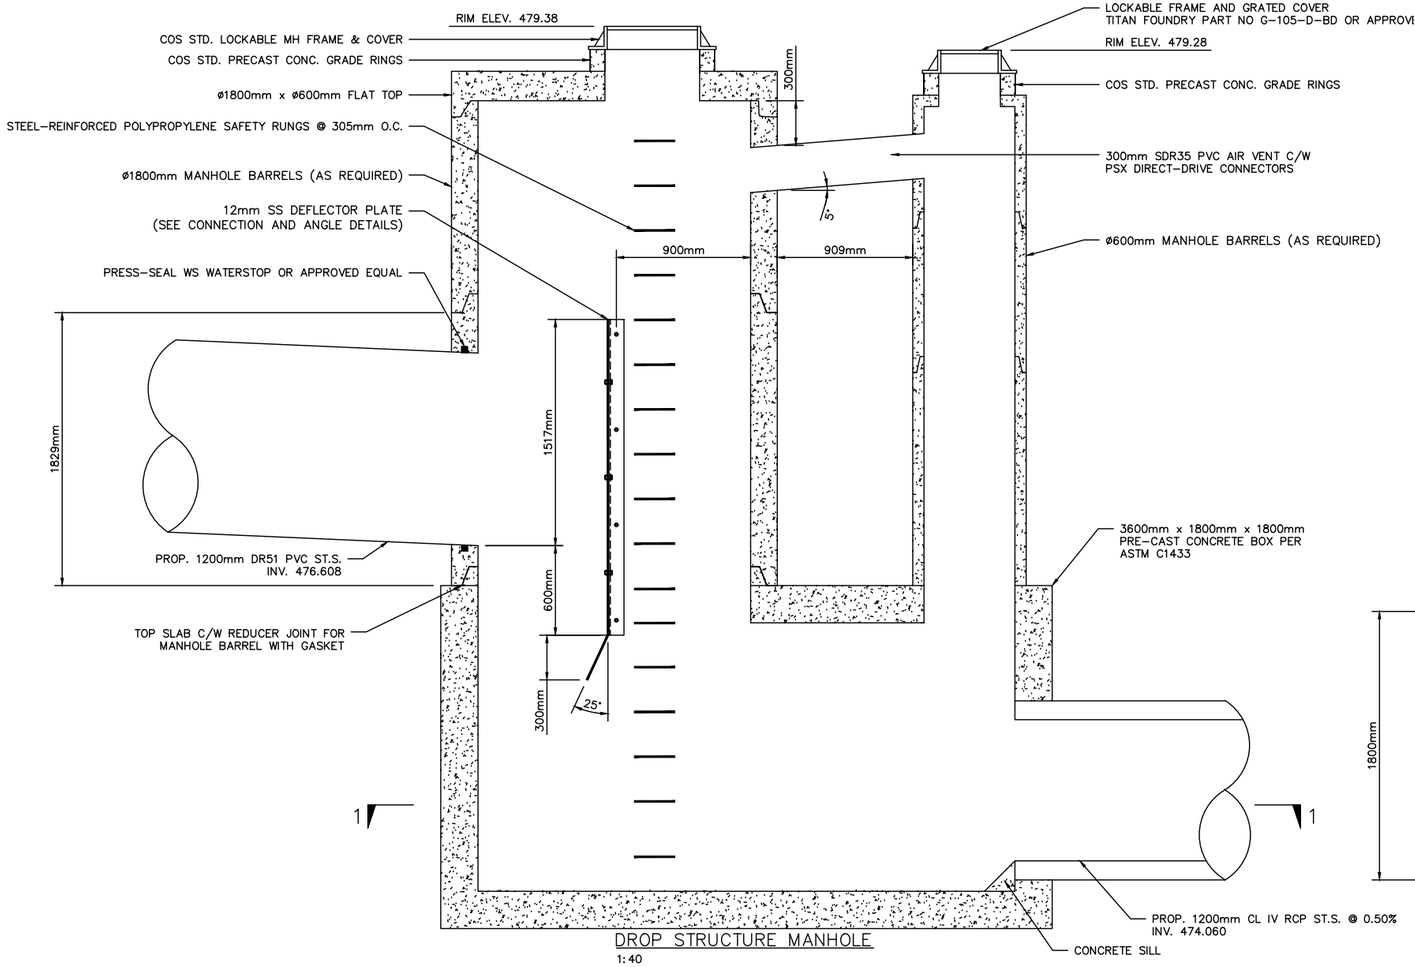


DROP STRUCTURE MANHOLE
1:40

NOTES

1. ALL CAST IN PLACE CONCRETE INCLUDING CHANNELING AND BENCHING TO BE 35 MPa (IN 28 DAYS) SULPHATE RESISTANT. ALL GROUT TO BE NON–SHRINK, TYPE HS SULPHATE RESISTANT, CEMENTITIOUS GROUT.
2. ALL PRECAST CONCRETE CIRCULAR SECTIONS SHALL BE MANUFACTURED IN ACCORDANCE WITH ASTM SPECIFICATION C478–C.O.S. SPEC'S.
3. ALL PRECAST CONCRETE BOX SECTIONS SHALL BE MANUFACTURED IN ACCORDANCE WITH ASTM SPECIFICATION C1433.
4. MANHOLE RUNGS SHALL NE ORIENTED SUCH THAT THEY DO NOT INTERFERE WITH THE INCOMING PIPE.
5. PIPE TO MANHOLE CONNECTIONS SHALL BE WATERTIGHT.
6. BACKFILL ABOVE PIPE ZONE SHALL BE CLASS II BACKFILL UNLESS NOTED OTHERWISE.

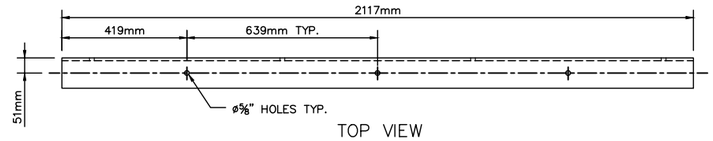


TOP VIEW

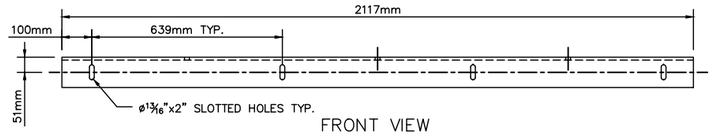


FRONT VIEW

DEFLECTOR PLATE MOUNTING ANGLE – DETAIL
1:20

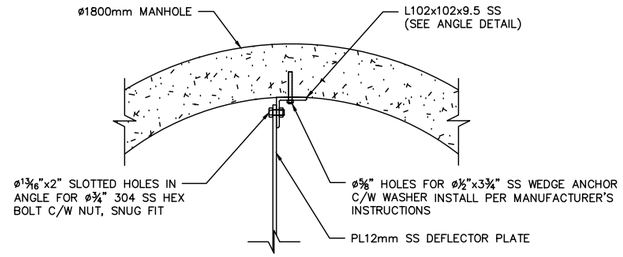

DEFLECTOR PLATE CONNETION – DETAIL
1:20

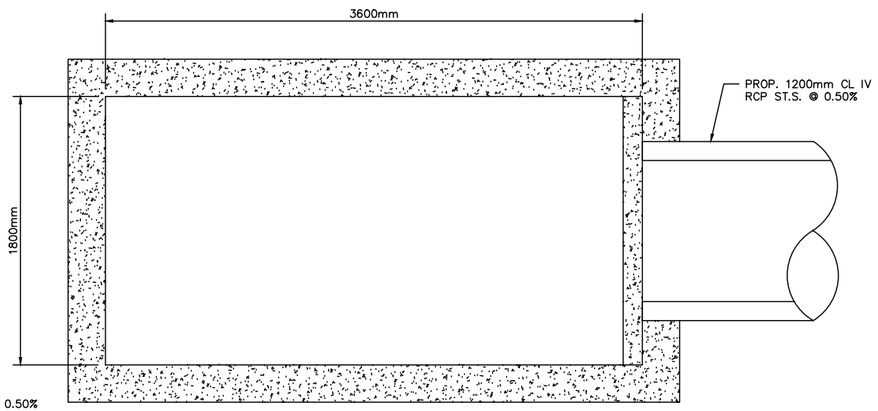

DROP STRUCTURE MANHOLE – SECTION 1
1:40

	PLAN DESCRIPTION/REVISION	DATE	BY
3	ISSUED FOR 100%	2026–MAR–09	RFC
2	ISSUED FOR 95%	2026–FEB–13	RFC
1	ISSUED FOR 60%	2026–JAN–15	RFC

SEAL

PROFESSIONAL ENGINEER
J.J GUILLOU
MEMBER 48265
2026-08-19
YR. MN. DAY
SASKATCHEWAN

Association of Professional Engineers & Geoscientists of Saskatchewan
CERTIFICATE OF AUTHORIZATION
CIMA CANADA
Number C1396
Permission to Consult held by:
Discipline: CIVIL | Sk. Reg. No.: 12178 | Signature

City of Saskatoon
Transportation and Construction Division

24th STREET FLOOD CONTROL STRATEGY

24th STREET
6th AVENUE TO RIVER
DETAILS


ENGINEERING MANAGER


SCALES:
HOR. AS NOTED
VERT. AS NOTED

DATE


SHEET NO.

PLAN NO.
C003

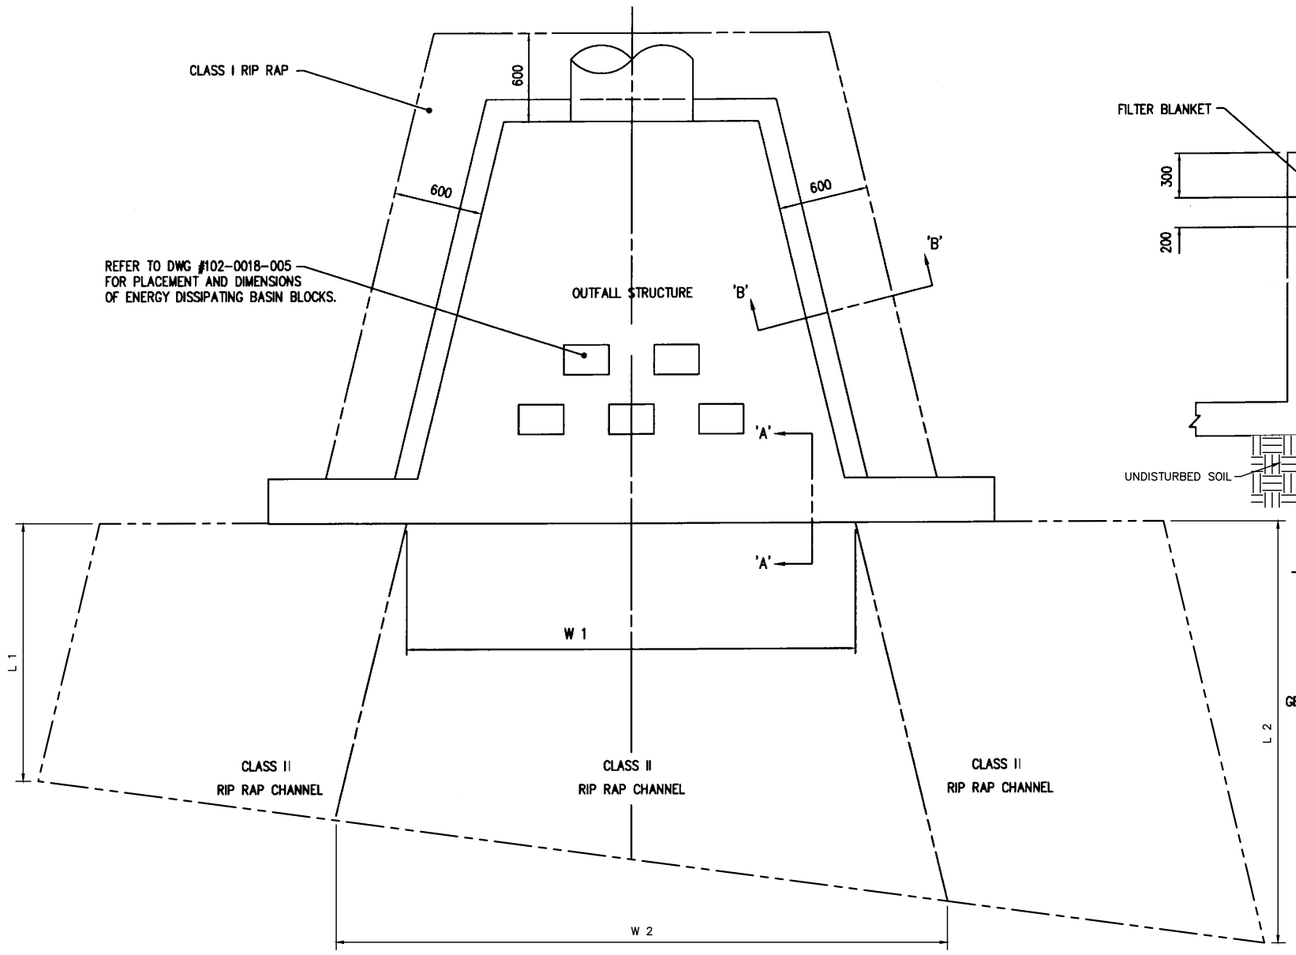

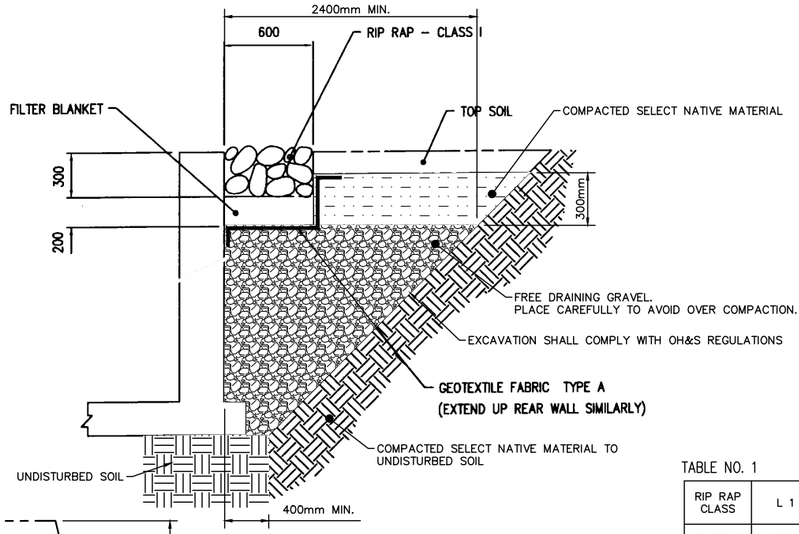

SECTION B – B

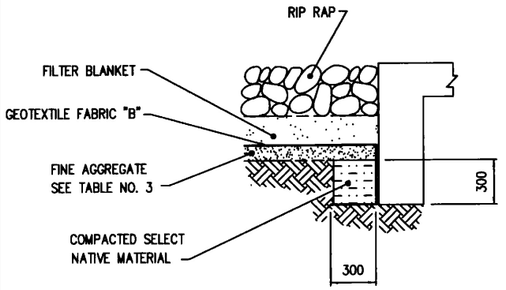

SECTION A – A

TABLE NO. 1

RIP RAP CLASS	L 1	L 2	W 1	W 2	X
CLASS II	2676	5847	3000	5000	1200

TABLE NO. 2


RIP RAP STONE SIZE				
% OF TOTAL WEIGHT SMALLER THAN GIVEN SIZE	CLASS I		CLASS II	
% PASSING	kg	DIA	kg	DIA
100	50	350	300	900
80	25	275	200	720
50	10	200	100	600
10	1	100	10	240

TABLE NO. 3

FILTER BLANKET						FINE AGGREGATE	
FREE DRAINING GRAVEL		FOR CLASS I RIP RAP		FOR CLASS I RIP RAP		% PASSING BY WEIGHT	SIZE
% PASSING	SIEVE SIZE	% PASSING	SIEVE SIZE	% PASSING	SIEVE SIZE		
100	38	100	38	100	50	100	10
65–100	10	90	25	80	38	97	5
50–90	5	70	18	60	25	88	2
35–75	2	45	10	45	18	63	900 µm
10–45	0.400	25	5	25	10	32	400 µm
0–20	0.150	10	2	10	5	7	160 µm
0–5	0.075						

TABLE NO. 4

GEOTEXTILE	
GEOTEXTILE "A"	MASS 240 g/m² THICKNESS 2.75 mm
GEOTEXTILE "B"	MASS 240 g/m² THICKNESS 3.30 mm

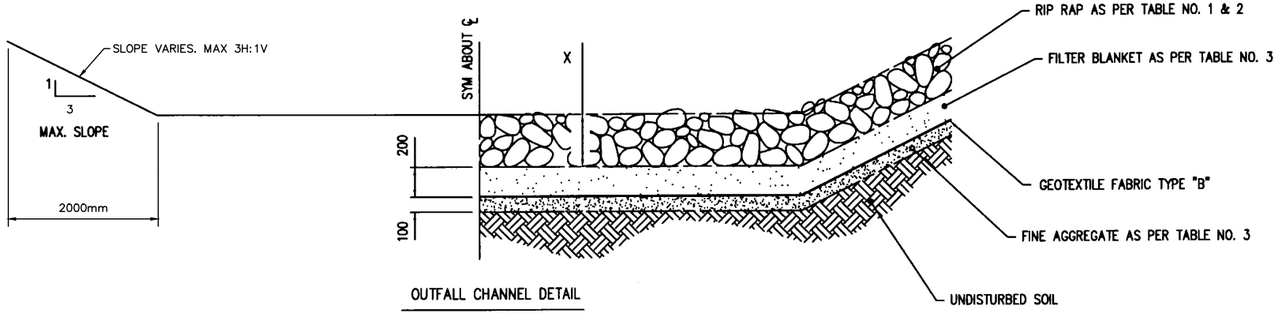

OUTFALL CHANNEL DETAIL

	PLAN DESCRIPTION/REVISION	DATE	BY
3	ISSUED FOR 100%	2026-MAR-09	RFC
2	ISSUED FOR 95%	2026-FEB-13	RFC
1	ISSUED FOR 60%	2026-JAN-15	RFC

SEAL

PROFESSIONAL ENGINEER
J.J. GUILLOU
MEMBER 48255
2026-08-19
YR. MN. DAY
SASKATCHEWAN


Association of Professional Engineers & Geoscientists of Saskatchewan
CERTIFICATE OF AUTHORIZATION
CIMA CANADA
Number C1396
Permission to Consult held by:
Discipline: CIVIL | Sk. Reg. No.: 12178 | Signature

City of Saskatoon
Transportation and Construction Division


24th STREET FLOOD CONTROL STRATEGY

24th STREET
6th AVENUE TO RIVER
STANDRAD RIPRAP DETAILS


ENGINEERING MANAGER
SCALES: HOR. 1:40 VERT.
DATE
SHEET NO.
PLAN NO.
C004

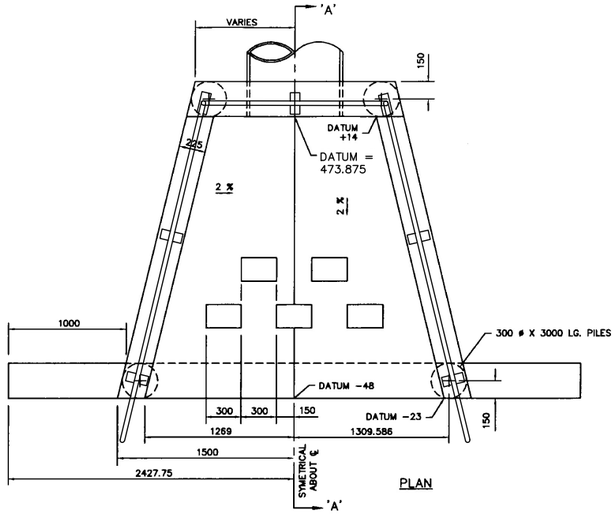


PLAN

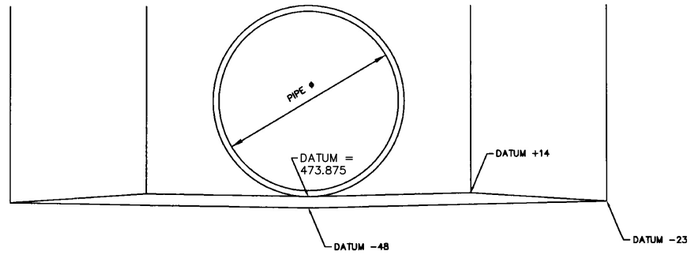

DETAIL A

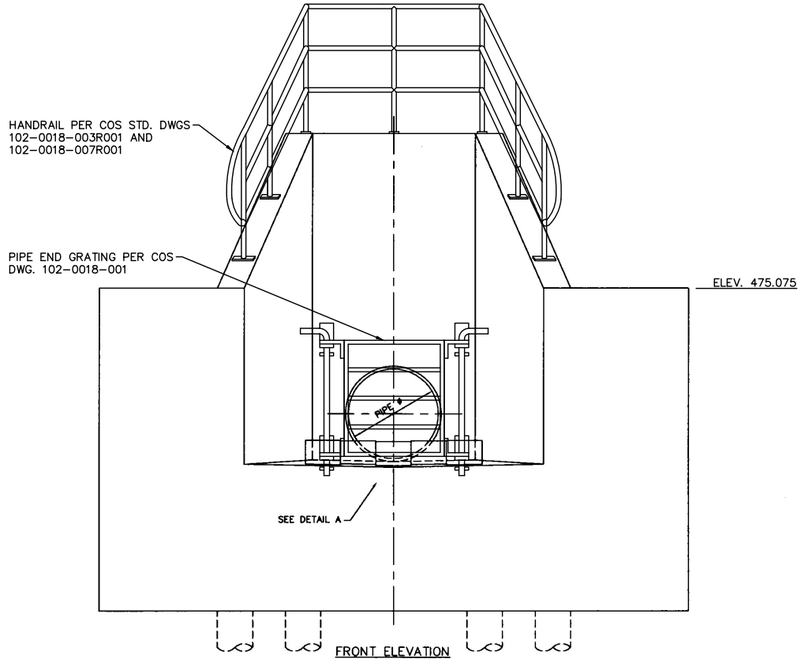

FRONT ELEVATION

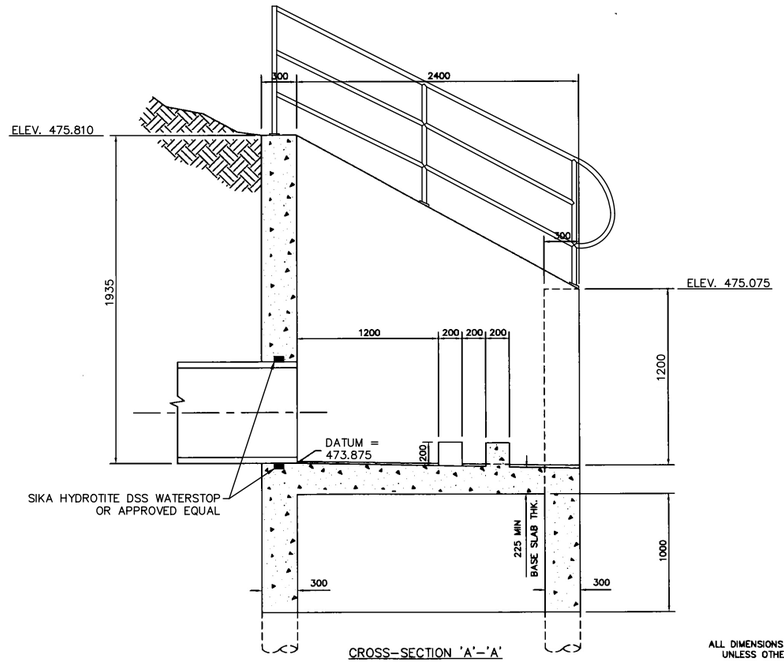

CROSS-SECTION 'A'-'A'

ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE NOTED

	PLAN DESCRIPTION/REVISION	DATE	BY
3	ISSUED FOR 100%	2026-MAR-09	RFC
2	ISSUED FOR 95%	2026-FEB-13	RFC
1	ISSUED FOR 60%	2026-JAN-15	RFC

SEAL

PROFESSIONAL ENGINEER
J.J. GUILLOU
MEMBER 48255
2026-08-19
YR. MN. DAY
SASKATCHEWAN

Association of Professional Engineers & Geoscientists of Saskatchewan
CERTIFICATE OF AUTHORIZATION
CIMA CANADA
Number C1396
Permission to Consult held by:

Discipline	Sk. Reg. No.	Signature
CIVIL	12178	

City of Saskatoon
Transportation and Construction Division

24th STREET FLOOD CONTROL STRATEGY

24th STREET
6th AVENUE TO RIVER
STORM SEWER OUTFALL DETAILS


ENGINEERING MANAGER

SCALES:
HOR. 1:50
VERT.


DATE

SHEET NO.


PLAN NO.
C005

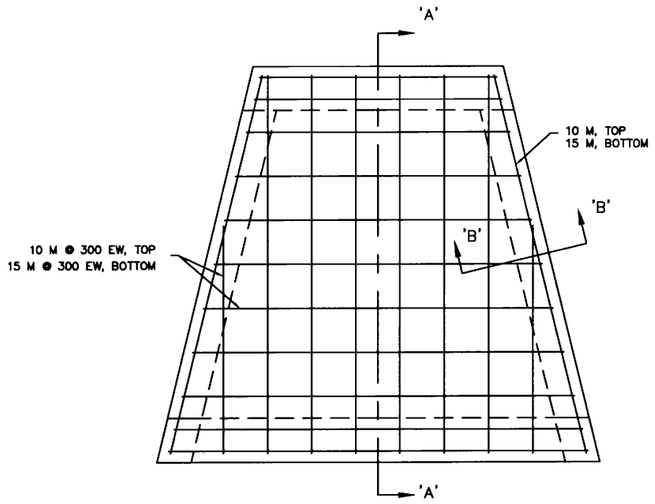


BASE SLAB REINFORCEMENT

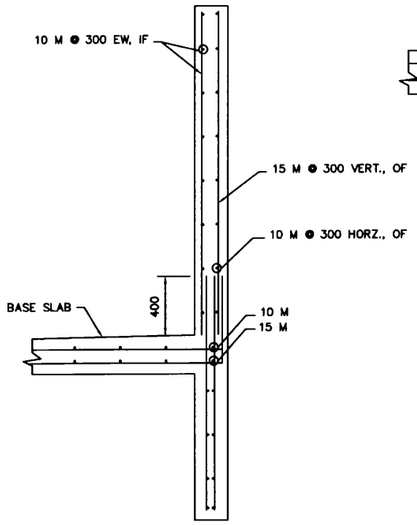

SECTION B – B

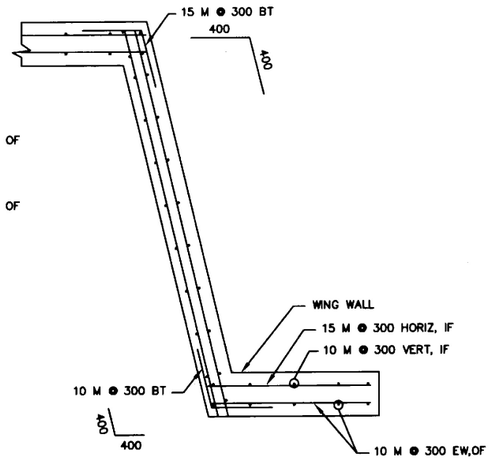


SECTION 'C'–'C'




ENERGY DISSIPATION BLOCK
1:10

GENERAL NOTES


1. CONCRETE COVER FOR REINFORCING STEEL, UNLESS OTHERWISE NOTED ON DRAWING, SHALL BE
   a) 75 CLEAR – FORMED CONCRETE EXPOSED TO EARTH.
   b) 50 CLEAR – FORMED CONCRETE EXPOSED TO WATER OR WEATHER.
2. SULPHATE RESISTANT CONCRETE TO BE USED (30 MPa IN 28 DAYS) MAX. 19mm AGGREGATE.
3. ALL EXPOSED EDGES OF WALLS TO BE CHAMFERED.
4. USE DEFORMED BARS, fy = 400MPa.
5. ALL FORMED SURFACES TO BE IN CONTACT WITH EARTH BACKFILL SHALL BE COVERED WITH TWO COATS OF EMULSIFIED ASPHALT WATERPROOFING.
6. CUT OR SPLAY REINFORCING STEEL AS REQUIRED FOR PIPE CLEARANCE.
7. BENDS IN REINFORCING STEEL SHALL CONFORM TO STANDARD BENDING DETAILS IN A.C.I. "351 – 80"
8. SPLICES OF REINFORCEMENT SHALL BE MADE ONLY AS REQUIRED OR PERMITTED ON DESIGN DWGS., IN SPECIFICATION OR AS AUTHORIZED BY THE DESIGN ENGINEER.
9. FOOTINGS TO REST ON UNDISTURBED SOIL.
10. CONCRETE AIR ENTRAINMENT SHALL BE 5–8%.
11. CURE CONCRETE PER CSA A23.1–19, TABLE 19, TYPE 1.

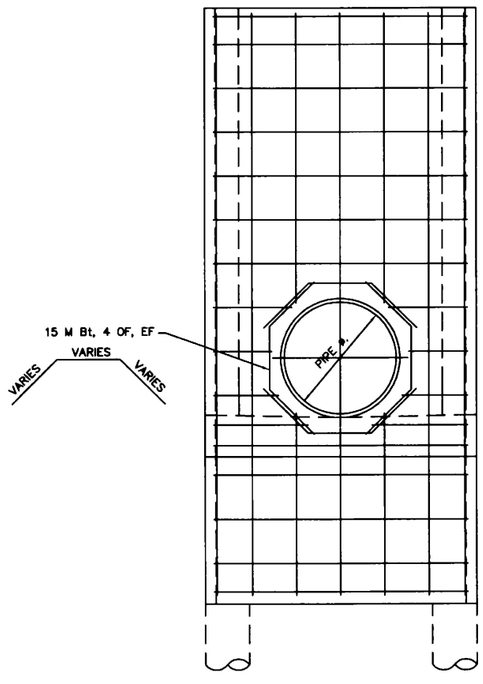

REAR WALL REINFORCEMENT

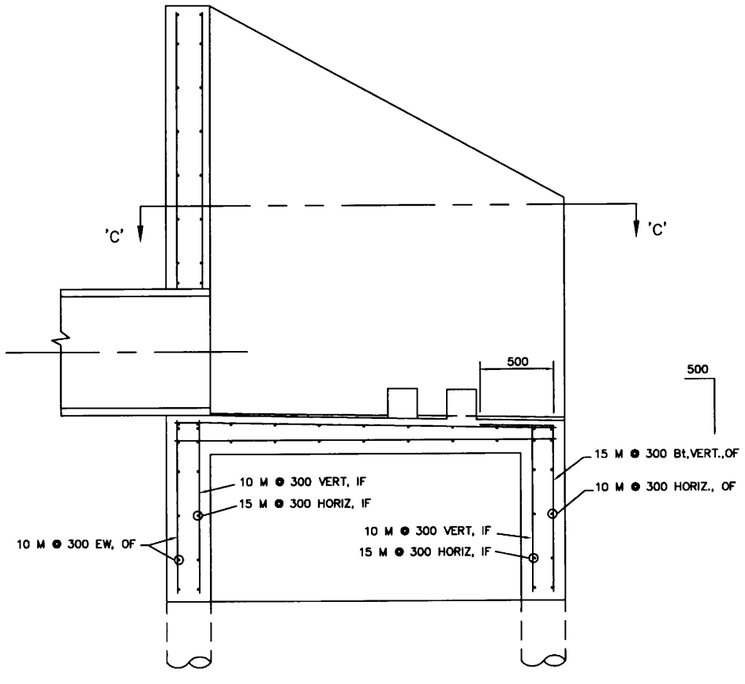

SECTION A – A

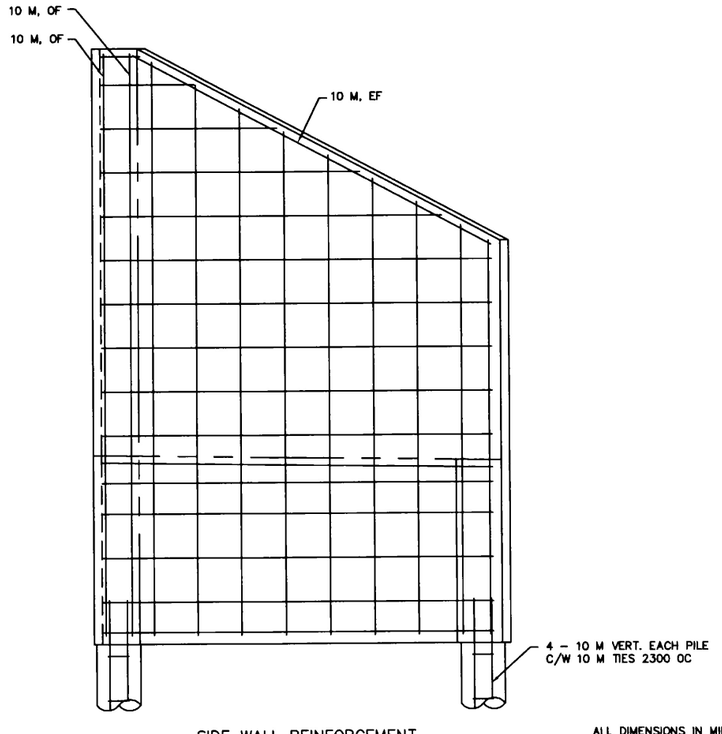

SIDE WALL REINFORCEMENT

ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE NOTED

3	ISSUED FOR 100%	2026–MAR–09	RFC
2	ISSUED FOR 95%	2026–FEB–13	RFC
1	ISSUED FOR 60%	2026–JAN–15	RFC
	PLAN DESCRIPTION/REVISION	DATE	BY

SEAL

PROFESSIONAL ENGINEER
J.J. GUILLOU
MEMBER 48265
2026-08-19
YR. MN. DAY
SASKATCHEWAN

Association of Professional Engineers & Geoscientists of Saskatchewan
CERTIFICATE OF AUTHORIZATION
CIMA CANADA
Number C1396
Permission to Consult held by:
Discipline: CIVIL | Sk. Reg. No.: 12178 | Signature

City of Saskatoon
Transportation and Construction Division

24th STREET FLOOD CONTROL STRATEGY

24th STREET
6th AVENUE TO RIVER
STORM SEWER OUTFALL REINFORCEMENT DETAILS


ENGINEERING MANAGER

SCALES:
HOR. AS NOTED
VERT. AS NOTED

DATE

SHEET NO.

PLAN NO.
C006

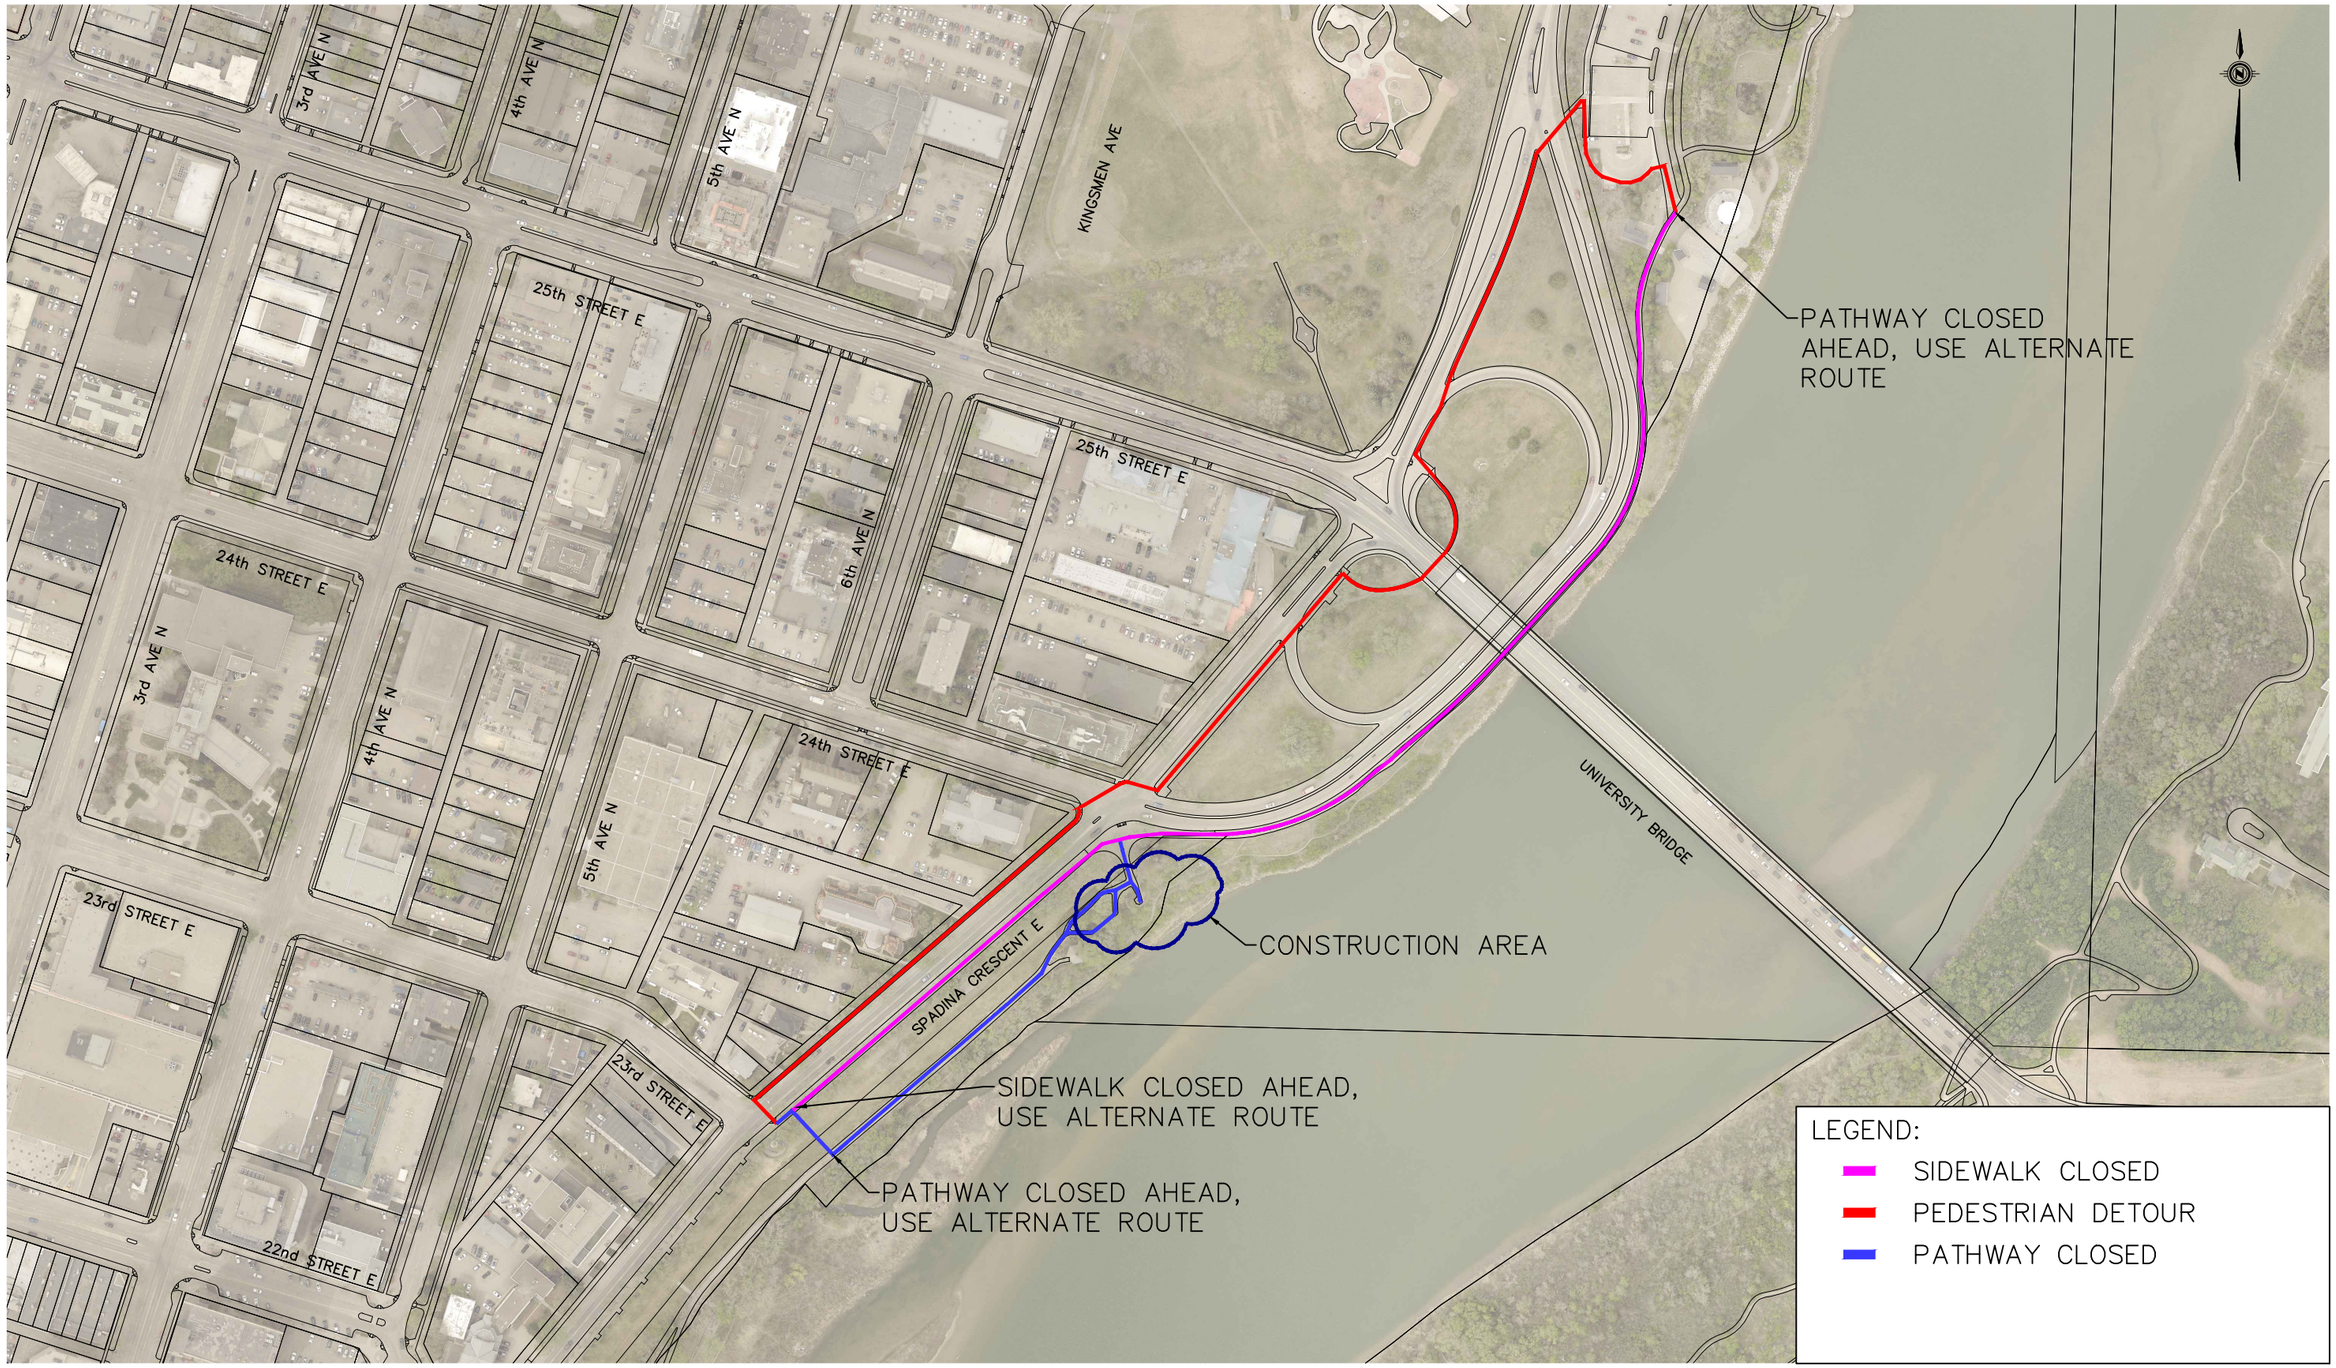

X	DESCRIPTION OF REVISION	20YY-MON-DD	XXX	
	PLAN DESCRIPTION/REVISION	DATE	BY	SEAL

CHECKED BY:	CHECKED BY:
SIGNATURE	SIGNATURE
NAME	NAME
DATE	DATE

DRAWN BY XXX DATE 20YY-MON-DD DWG STDS CHECKED BY XXX DATE 20YY-MON-DD

City of Saskatoon
Transportation and Construction Division

PEDESTRIAN DETOUR PLAN

ENGINEERING MANAGER

SCALES: HOR. 1:3000 VERT: N/A

DATE

SHEET NO. 1 OF 1

PLAN NO. XXX-XXXX-XXXr00X



Meewasin

Meewasin Valley Authority
402 Third Avenue South
Saskatoon, SK S7K 3G5
Tel 306-665-6887
Fax 306-665-6117

GENERAL NOTES

LEGEND:

- Proposed Trail
- Mulch Area (950m2)
- Sod Repair Zone (44m2)
- Naturalized Planting Bed (810m2)
- B&B Tree (4)

NO.	ISSUE NOTES	DATE
1	ISSUED FOR REVIEW	2026-09-29

PROFESSIONAL SEALS:

PROJECT TITLE

CITY OF SASKATOON
24th STREET OUTFALL

DRAWING TITLE

PLANTING PLAN

DRAWN	REVIEWED	DRAWING NO.
JS	AO	
SCALE	PROJECT NO.	
1:200		REVISION